



Iss.	Date	Modification	Ckd.	Appd.
1	07.06 2017	.	.	.




**BEKA associates**  
Hitchin  
England  
company confidential, copyright reserved.

Iss.	Date	Modification	Ckd.	Appd.




TERMINAL CONNECTIONS:

Type of input can be selected on-site

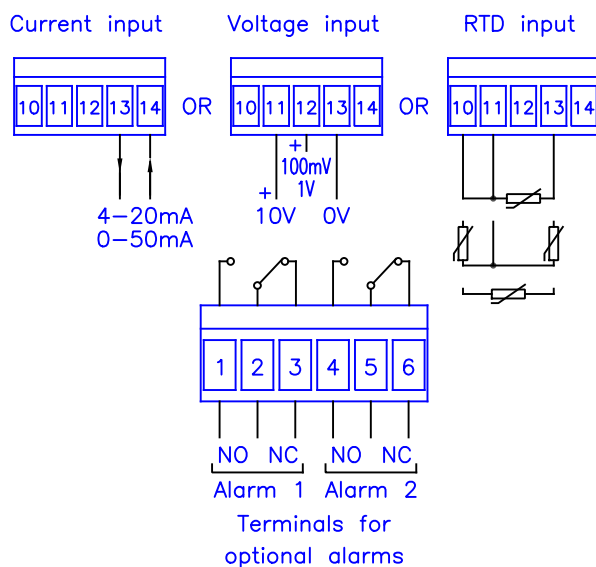

Terminal for optional  
4/20mA output

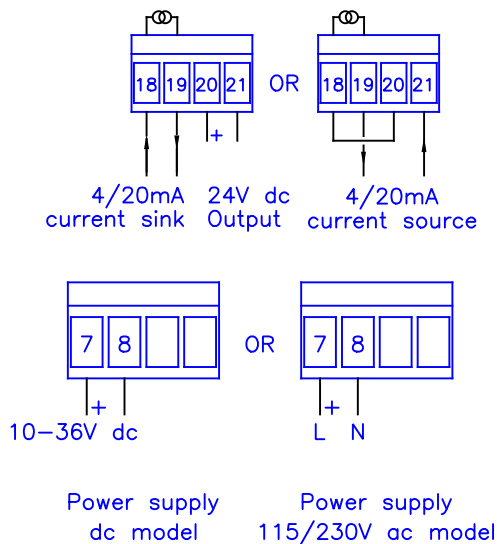

### INSTALLATION:

- 1 INSERT UNIT INTO PANEL CUTOUT FROM FRONT.
- 2 SCREW CLAMPS ARE CLIPPED TO THE INDICATOR  
& TIGHTENED FROM REAR OF PANEL.  
RECOMMENDED TORQUE 22cNm MAX.
- 3 FOR PANELS GREATER THAN 3mm THICK ADD  
ADDITIONAL DEPTH FOR CLAMPS.  
(ie ADD PANEL THICKNESS LESS 3mm)

PANEL CUTOUT:  
DIN 43 700:  $92^{+0.8}_{-0} \times 45^{+0.6}_{-0}$   
FOR IP66:  $90^{+0.5}_{-0} \times 43.5^{+0.5}_{-0}$

Drawn RH	Checked .	Scale NTS
Drawing No. CDA90		