

1. DESCRIPTION

The BA558E is a panel mounting, general purpose, 4/20mA rate totaliser primarily intended for use with flowmeters. It simultaneously displays the rate of flow (4/20mA current) and the total flow in engineering units on separate displays. It is loop powered but only introduces a 1.2V drop into the loop.

This abbreviated instruction sheet is intended to assist with installation and commissioning, a comprehensive instruction manual describing system design and configuration is available from the BEKA sales office or may be downloaded from our website.

2. INSTALLATION

The BA558E has IP66 front of panel protection but it should be shielded from direct sunlight and severe weather conditions. The rear of the rate totaliser has IP20 protection.

Cut-out dimensions

Recommended for all installations. Mandatory to achieve an IP66 seal between the instrument and the panel
136 +0.5/-0.0 x 66.2 +0.5/-0.0



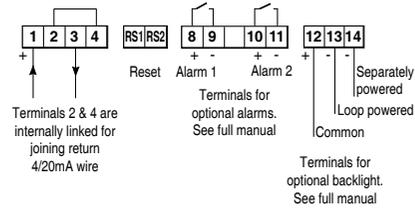


Fig 1 cut out dimensions & terminals


Abbreviated Instructions for BA558E General purpose, panel mounting loop powered rate totaliser

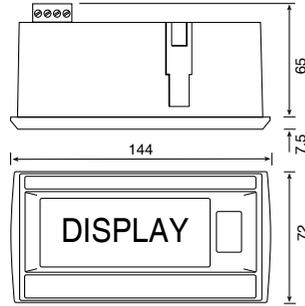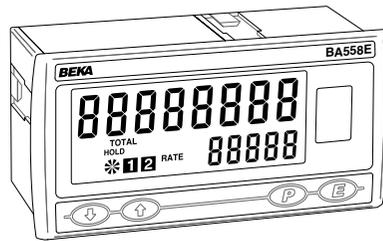

Issue 1
1st June 2012

BEKA associates Ltd. Old Charlton Rd, Hitchin, Hertfordshire, SG5 2DA, UK Tel: +44(0)1462 438301 Fax: +44(0)1462 453971 e-mail: sales@beka.co.uk web: www.beka.co.uk

1. Align foot and body of panel mounting clamp by turning screw anticlockwise



2. Position gasket behind instrument bezel

4. Insert panel clamp into recess and gently pull it onto the dovetail. Engage screw & turn clockwise to tighten the clamp, fit the other clamps. Recommended tightening torque 22cNm (1.95lbf.in) Equivalent to finger tight plus one half turn. DO NOT OVERTIGHTEN

3. Insert instrument into the panel from the front




Fig 2 Installation procedure

EMC

For specified immunity all wiring should be in screened twisted pairs, with the screens earthed at one point.

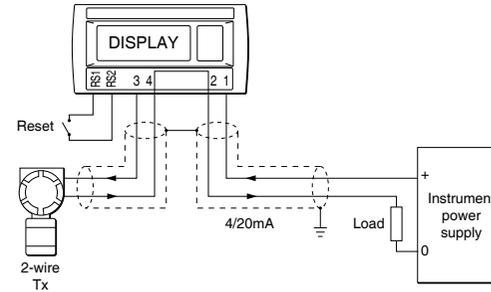


Fig 3 Typical measurement loop

Scale card

The rate totaliser's units of measurement are shown on a printed scale card visible through a window at the right hand side of the display. The scale card is mounted on a flexible strip that is inserted into a slot at the rear of the instrument as shown below.

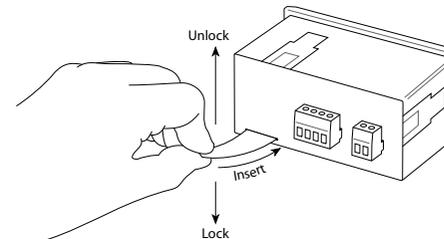



Fig 4 Inserting flexible strip carrying scale card into slot at the rear of indicator.

Thus the scale card can easily be changed without removing the instrument from the panel or opening the instrument enclosure.

New rate totalisers are supplied with a printed scale card showing the requested units of measurement, if this information was not supplied when the instrument was ordered a blank card will be fitted.

A pack of self-adhesive scale cards printed with common units of measurement is available as an accessory from BEKA associates. Custom printed scale cards can also be supplied.

To change a scale card, unclip the protruding end of the flexible strip by gently pushing it upwards and pulling it out of the enclosure. Peel the existing scale card from the flexible strip and replace it with a new printed card, which should be aligned as shown below. Do not fit a new scale card on top of an existing card.



Align the self-adhesive printed scale card onto the flexible strip and insert the strip into the indicator as shown above.

Fig 5 Fitting scale card to flexible strip

3. OPERATION

The BA558E is controlled and configured via the four front panel push buttons located below the display. In the display mode i.e. when the instrument is totalising, these push buttons have the following functions:

- P** Displays input current in mA or as a percentage of span. (configurable function)
Modified when optional alarms are fitted.
- ▼** Shows rate display calibration at 4mA input
- ▲** Shows rate display calibration at 20mA input
- E** Shows time since instrument was powered or total display was reset.
- E+▼** Grand total displays least significant 8 digits
- E+▲** Grand total displays most significant 8 digits
- ▼+▲** Resets total display (configurable function)
- P+▼** Shows firmware version
- P+▲** Optional alarm setpoint access
- P+E** Access to configuration menu

The BA558E is CE marked to show compliance with the EMC Directive 2004/108/EC.

